

# Orange County Sanitation District Wastewater Treatment

Presented By:  
April Frost, Chief  
Plant Operator  
Plant No. 1


Operations  
Committee

May 4, 2022



1

## Water Reclamation Process

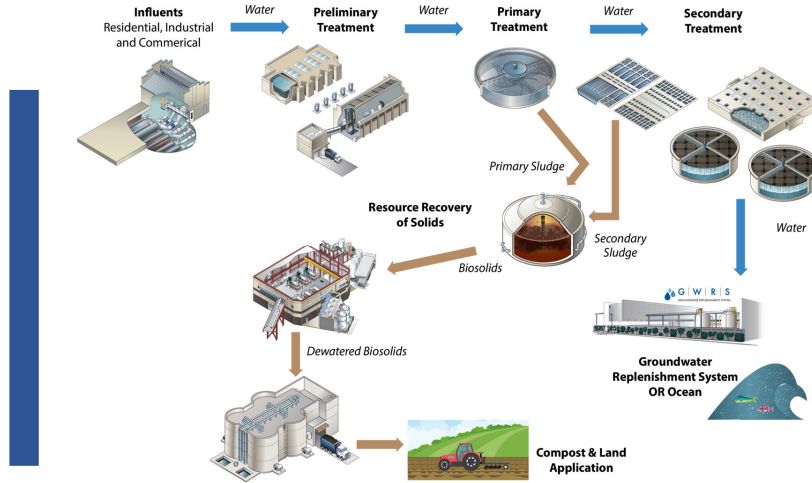

2

2

## Metering and Diversion Structure



3


3

## Preliminary Treatment

Barscreen



Grit Chamber

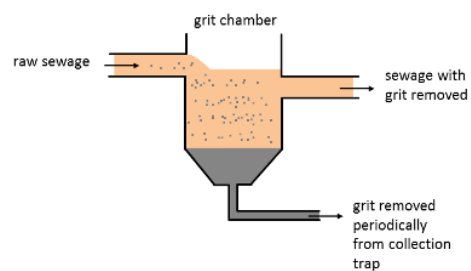



Grit is mostly inorganic material like sand, gravel, and eggshells.

Grit is very abrasive and heavy. It clogs flow channels and digesters and wears out pumps.

4

4


# Primary Treatment

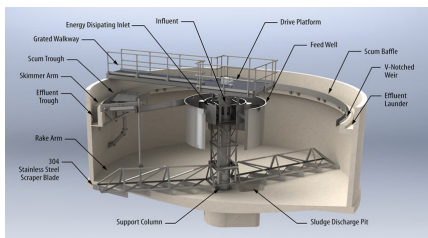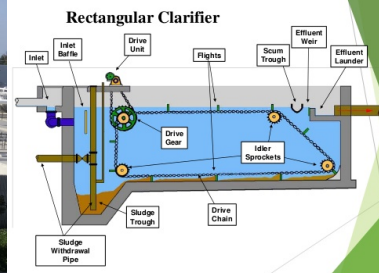

5

# Secondary Treatment

## Activated Sludge Process

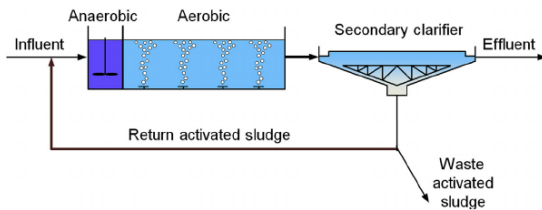

Trickling Filter at Plant No. 1



6

6

## Effectiveness of Water Treatment

Raw Sewage



Primary Treated Effluent



Secondary Treated Effluent



7

7

## Solids Recovery Process

Anaerobic Digester




8

8

# Dewatering Operation



Centrifuge System  
at Plant No. 1

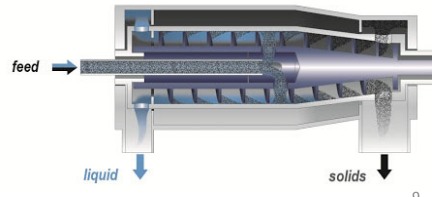

9

9

# Truckloading



10

10

## Central Generation Engines



Plant No. 2 Central Generation Engines

11

11

## Evolution of Ocean Discharge

Fiscal Year	OC San Daily Ocean Outfall Effluent Average [MGD]
1990-1991	262
1996-1997	242
2008-2009 (GWRS starts)	167
2015-2016 (GWRS Initial Expansion)	92
2019-2020 (Most recent year)	101
2022-2024 (GWRS Final Expansion)	~40-60*

\*mostly non-reclaimable : SAWPA discharge and GWRS RO reject




12

12

## Agency Partnerships

Coordination and Communication to ensure Discharge Quality for OCWD and the Ocean Outfall

- Flow management and infrastructure soundness
- Change in wastewater stream/source
- Change in influent and effluent characteristics
- Change in operations

Urban Runoff

13

13

## Environmental Compliance and Reporting Governance

FEDERAL


United States Environmental Protection Agency

---

STATE









---

REGIONAL/LOCAL









14

14

7

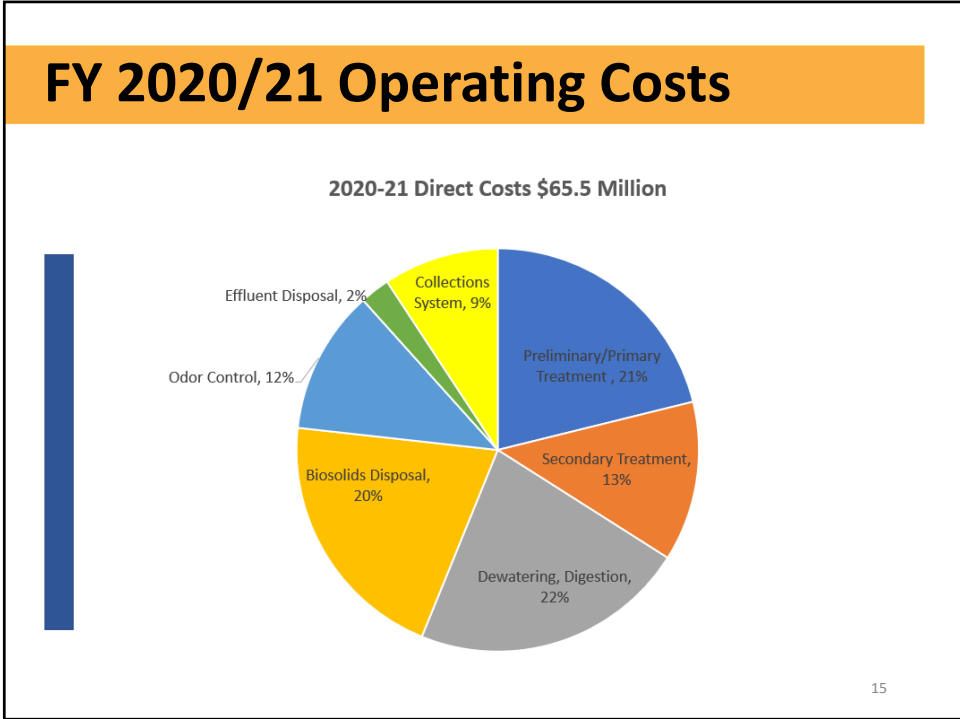

15

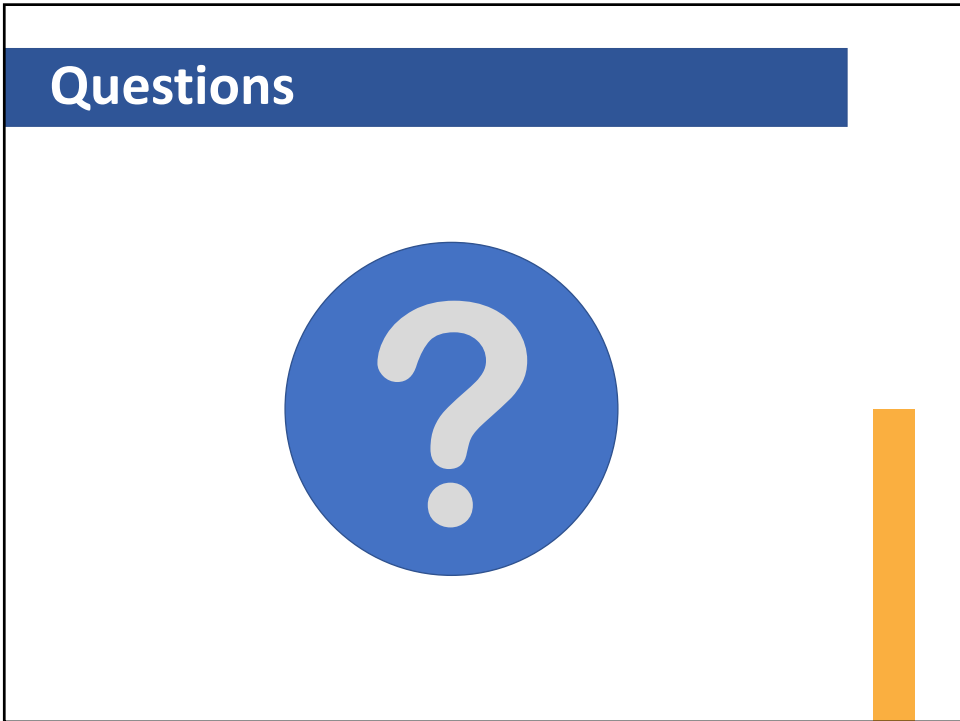

16