



Item 4
Bay Bridge Pump Station Force Main Isolation Valve Replacement
Project No. FRC-0013

Item 5
Bay Bridge Pump Station Valve Replacement
Project No. FRC-0002


Presented by:
Kathy Millea
Director of Engineering

Steering Committee
August 25, 2021



1

Site Vicinity



Treatment Plant No. 2

Bay Bridge Pump Station

2

2

Bay Bridge Pump Station Location



3

3

Coast Highway Street View



4

4

Pumps Needing Repair




5


Leaking Pump




6

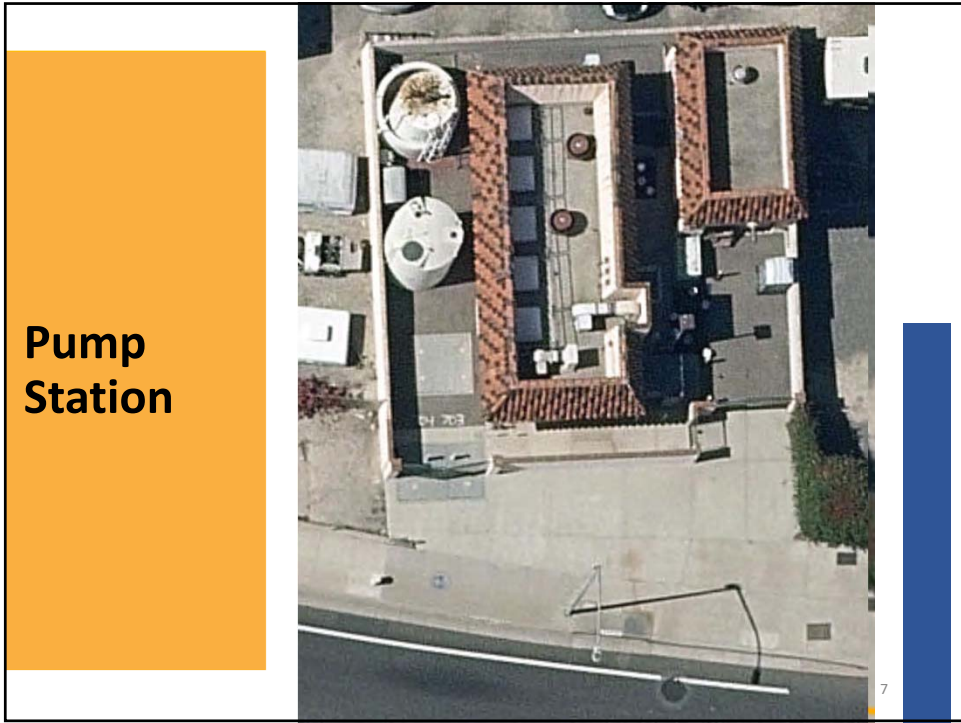


7

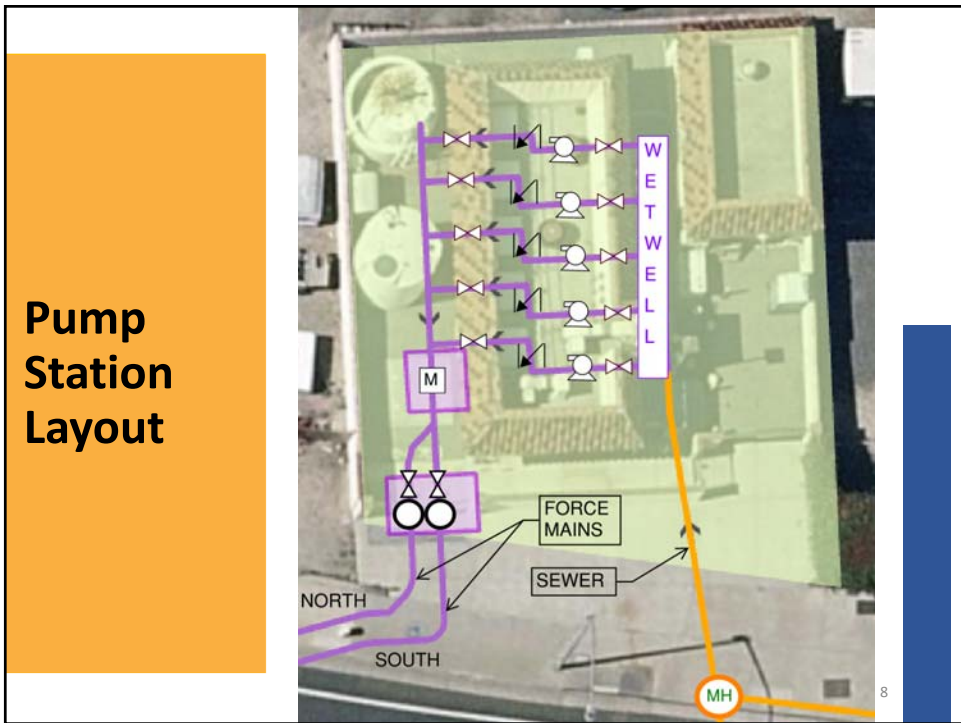


8

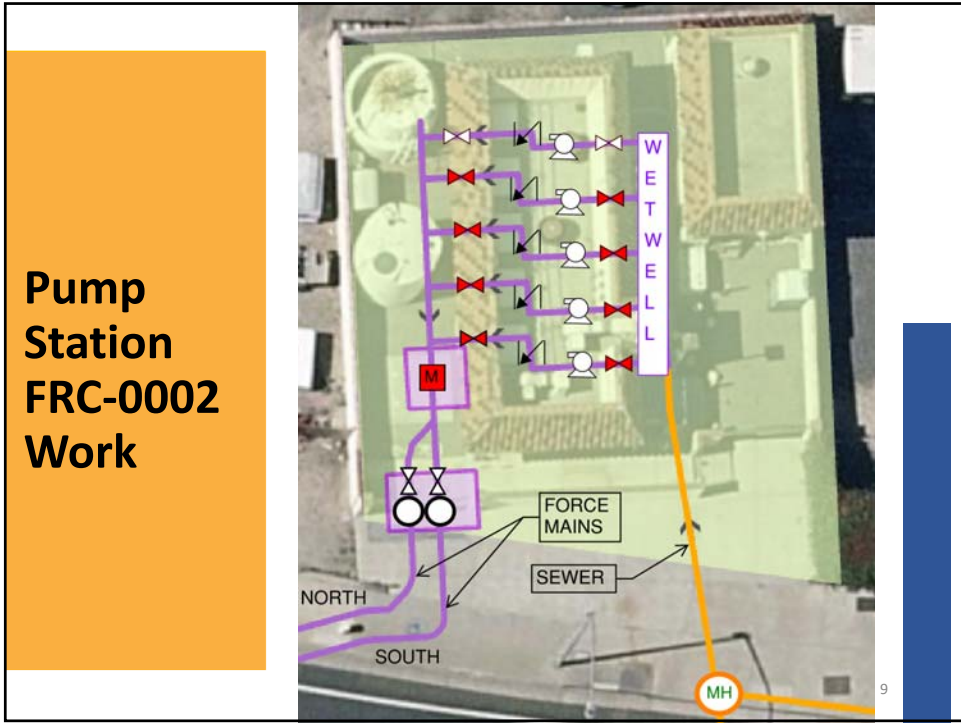


9

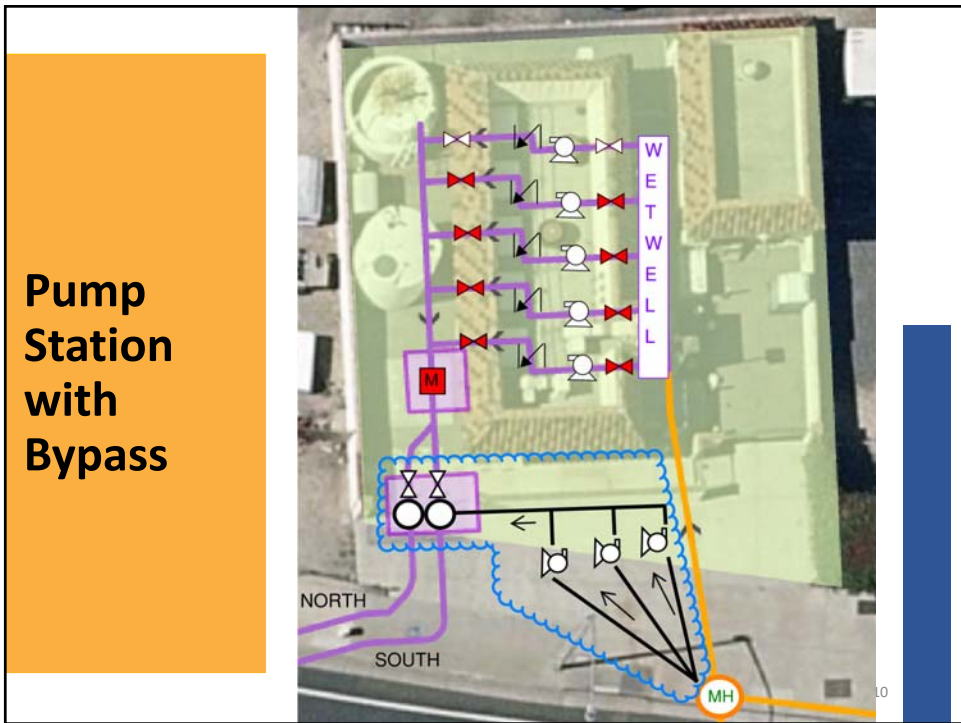


10

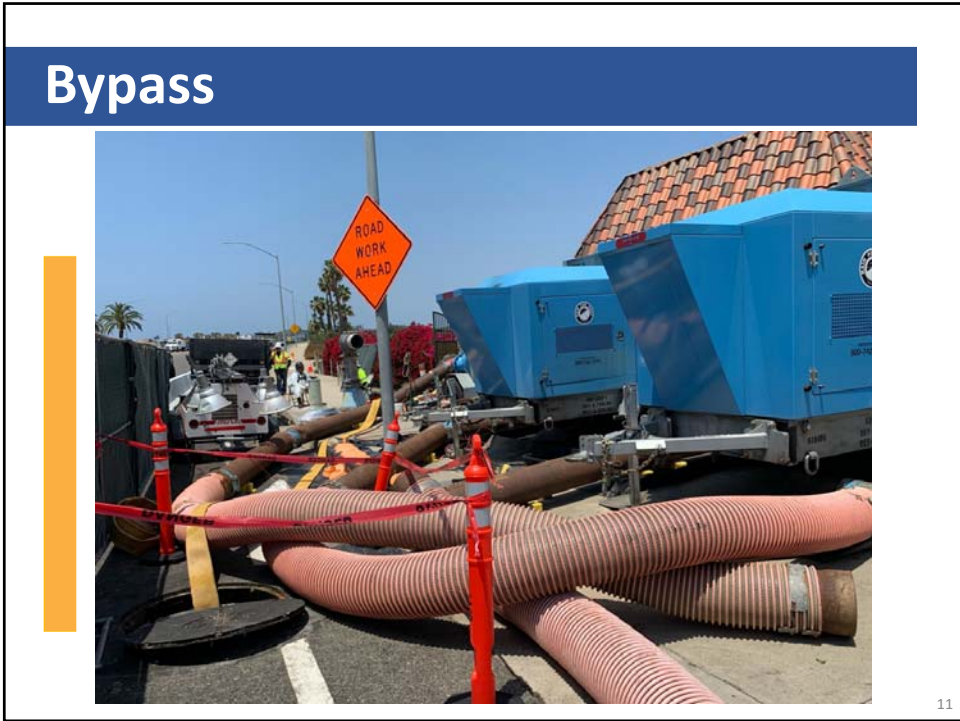

11

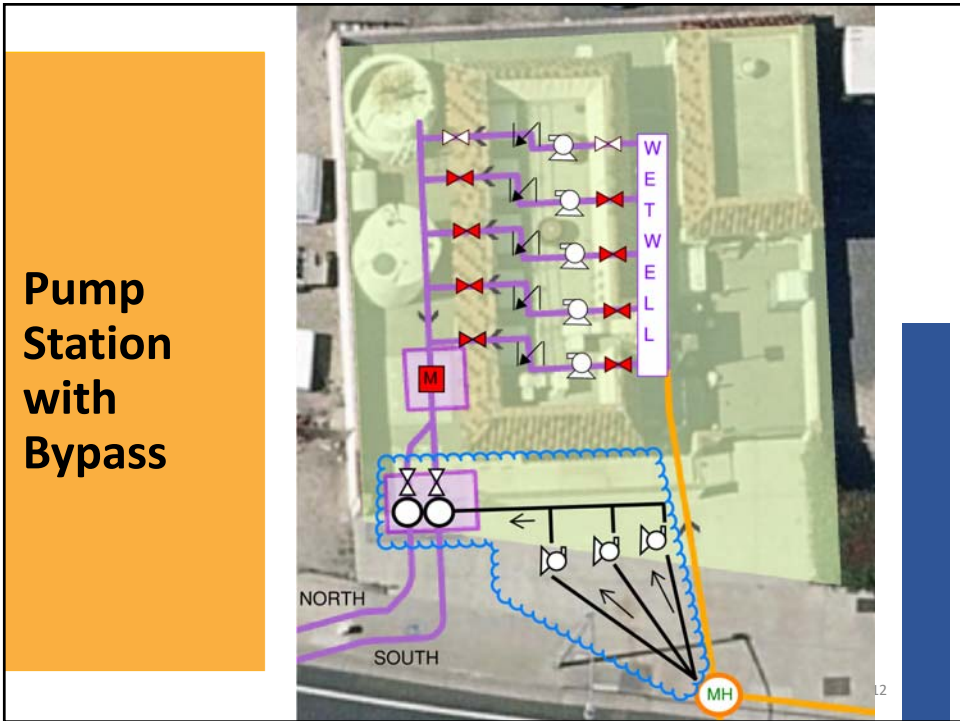

12

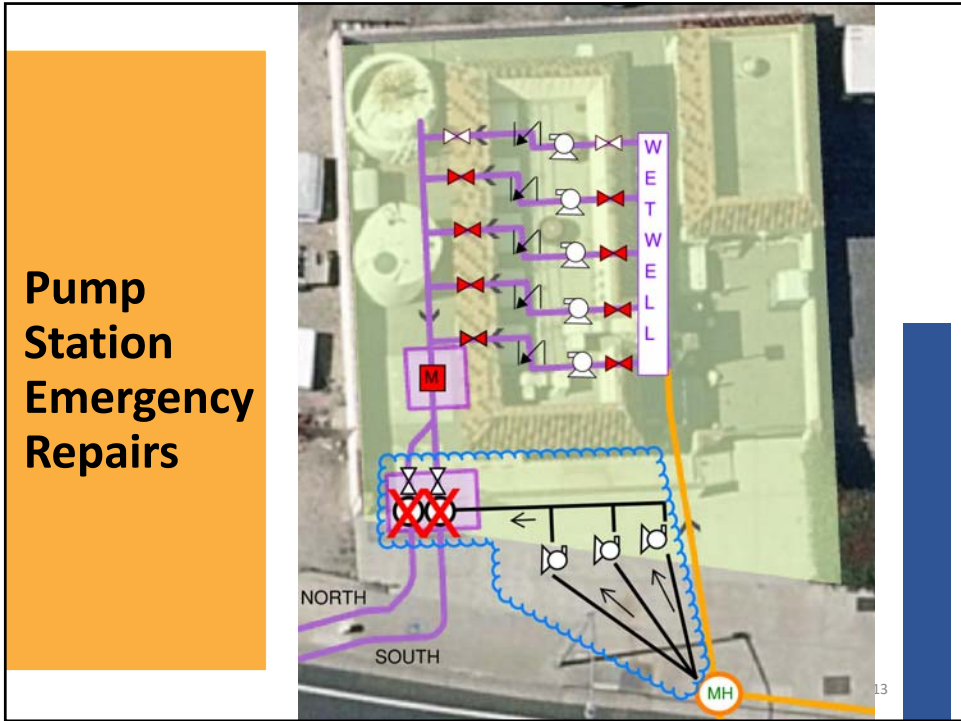

13

Item 4 Recommendation

Force Main Isolation Valve Replacement
Recommend to the Board of Directors to:

- A. Ratify Approval of an Emergency Repair Service Contract to Charles King Company for Bay Bridge Pump Station Force Main Isolation Valve Replacement, Project No. FRC-0013, for an amount not to exceed \$289,585; and
- B. Approve a contingency of \$144,793 (50%).

14

Item 5 Recommendation

Pump Station Valve Replacement

Recommend to the Board of Directors to:

Approve a contingency increase of \$269,100 (45%) to the service contract with Innovative Construction Solutions for Bay Bridge Pump Station Valve Replacement, Project No. FRC-0002, Specification No. S-2020-1192BD, for a total contingency of \$328,900 (55%).

15

15

Questions



16

16